


SCHWINGGESCHWINDIGKEIT



DATEI: 2492-PG14-09062026-073102_raw.csv		
Aufzeichnungsdauer: 6.38 s Abtastrate: 1000 Hz		
Datum:	09.06.2026	
Zeit:	07:31:02	
Event-ID:	2492-PG14-09062026-073102	
Kalibrier Datum:	12.07.2025	
Spitzwerte		
V-x (Longitudinal)	V-y (Transversal)	V-z (Vertikal)
1.80 mm/s	0.64 mm/s	2.87 mm/s
34.5 Hz	40.3 Hz	95.1 Hz
16.22% von Limit	5.13% von Limit	14.73% von Limit
V-n (Vektorsumme): 3.09 mm/s		

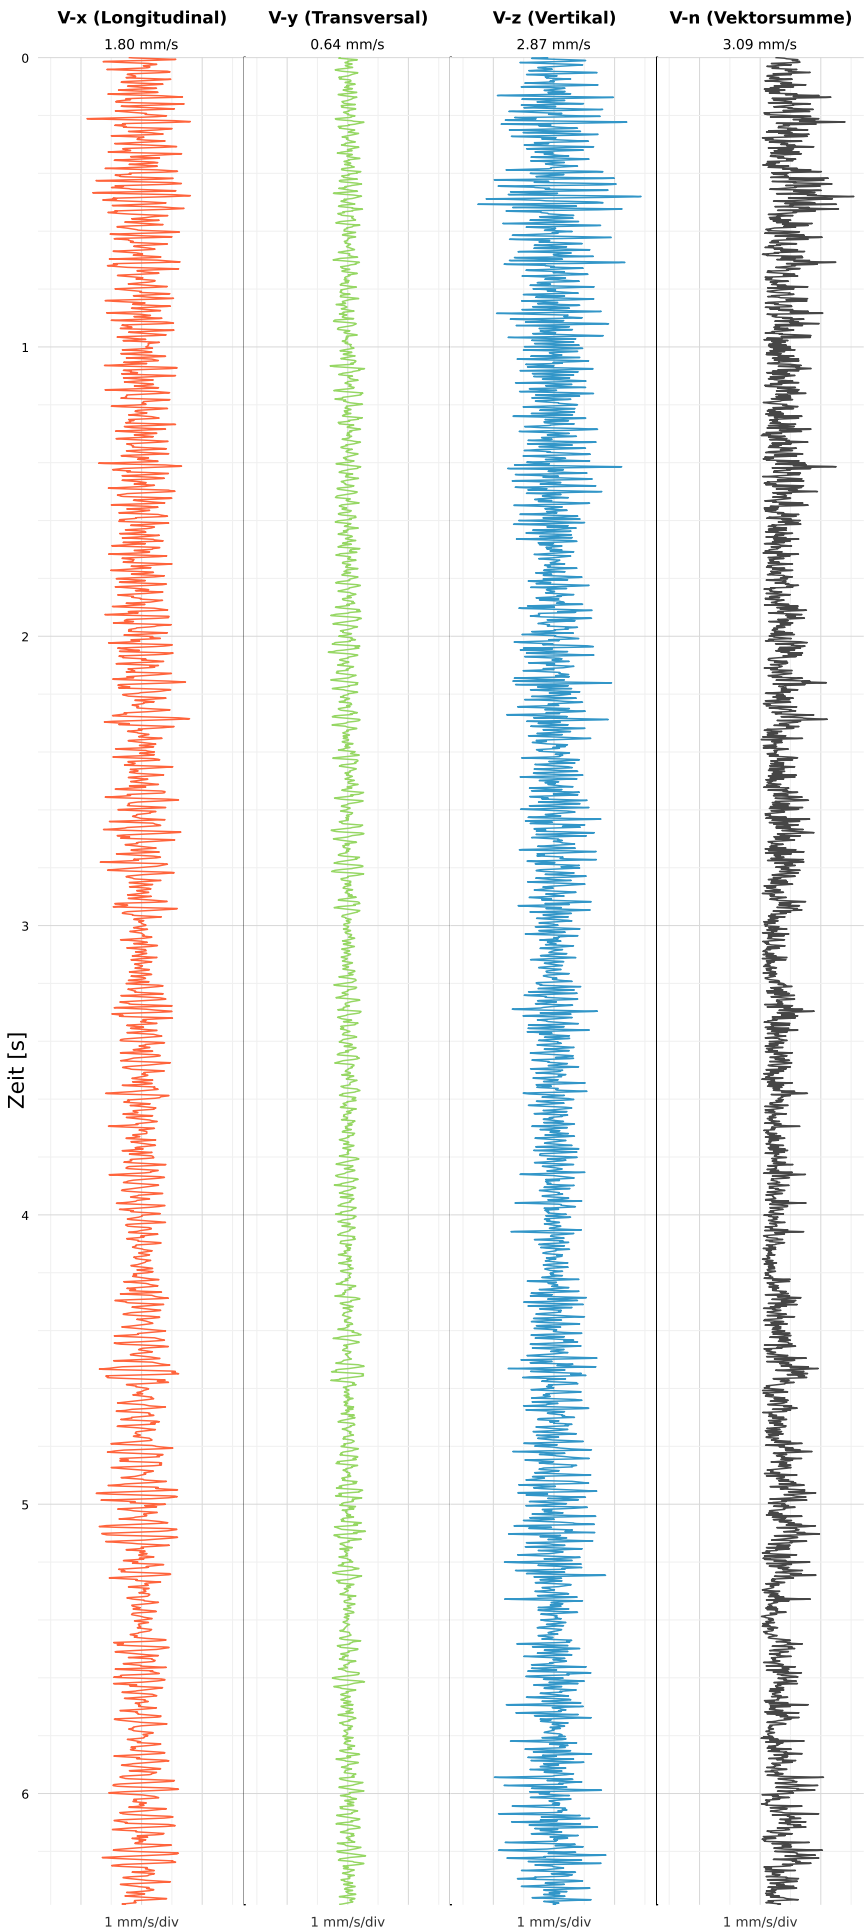