


SCHWINGGESCHWINDIGKEIT

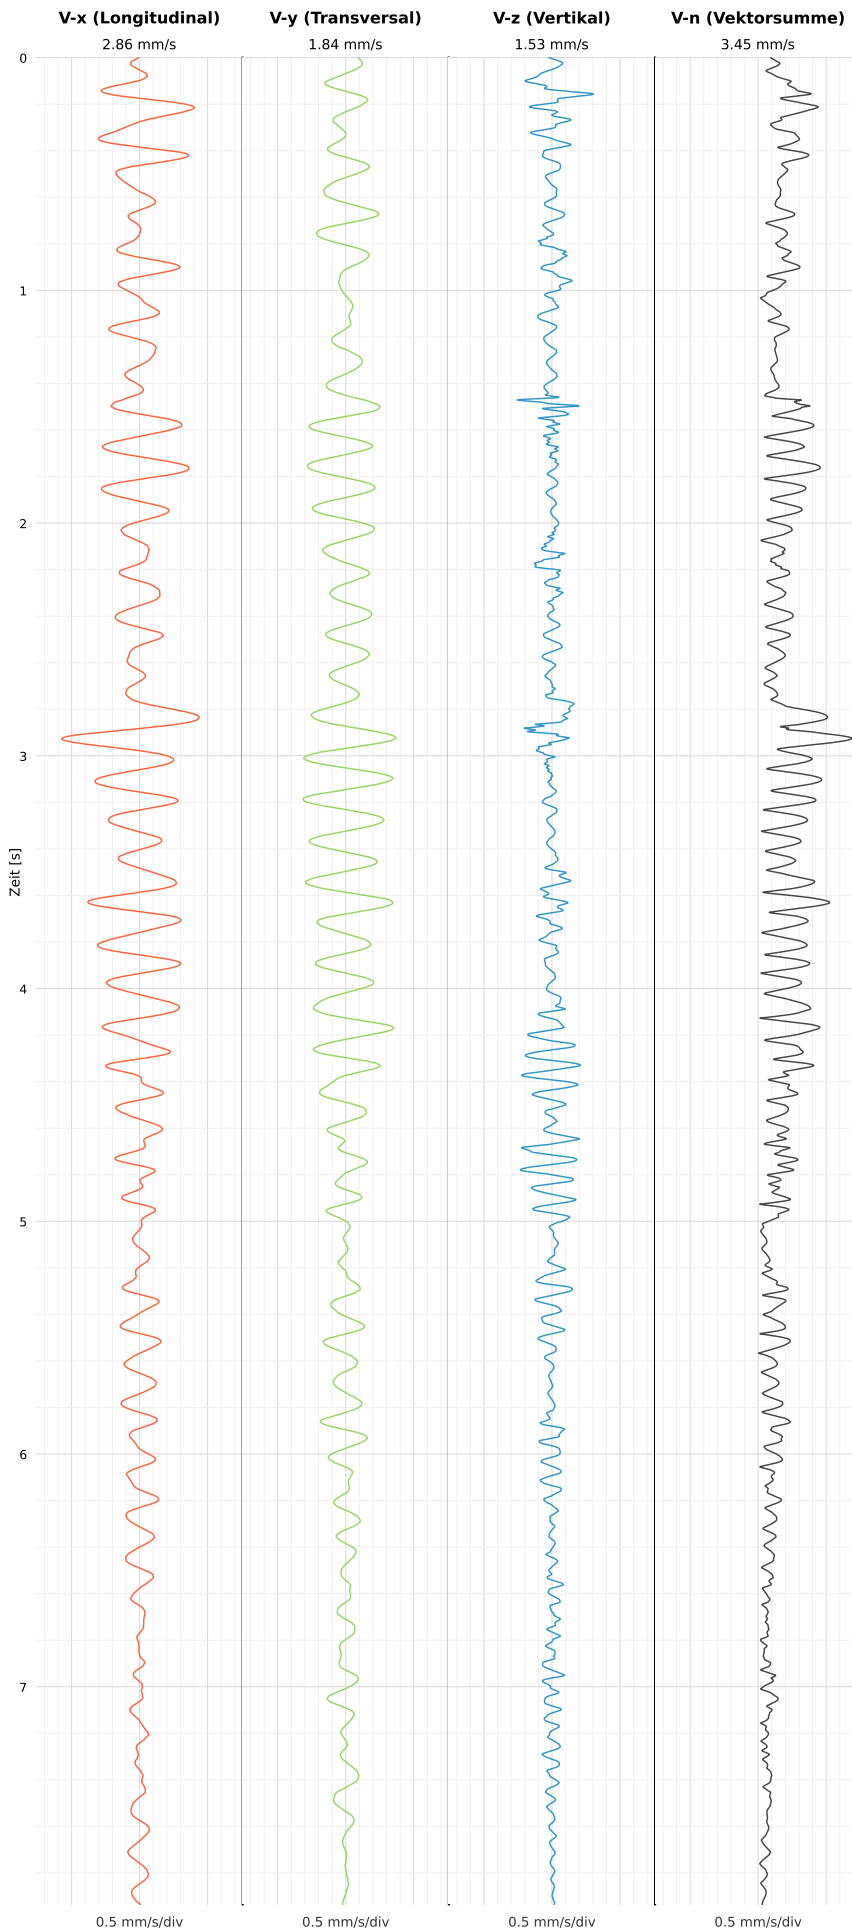


DATEI: 2492-PG8-19052026-144944_raw.csv

Aufzeichnungsdauer: 7.94 s | Abtastrate: 1000 Hz

Datum	19.05.2026
Zeit	14:49:44
Event-ID	2492-PG8-19052026-144944
Status	Hinweis
X	2.86 mm/s @ 5.7 Hz
Y	1.84 mm/s @ 5.5 Hz
Z	1.53 mm/s @ 12.2 Hz
Vn	3.45 mm/s @ 5.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

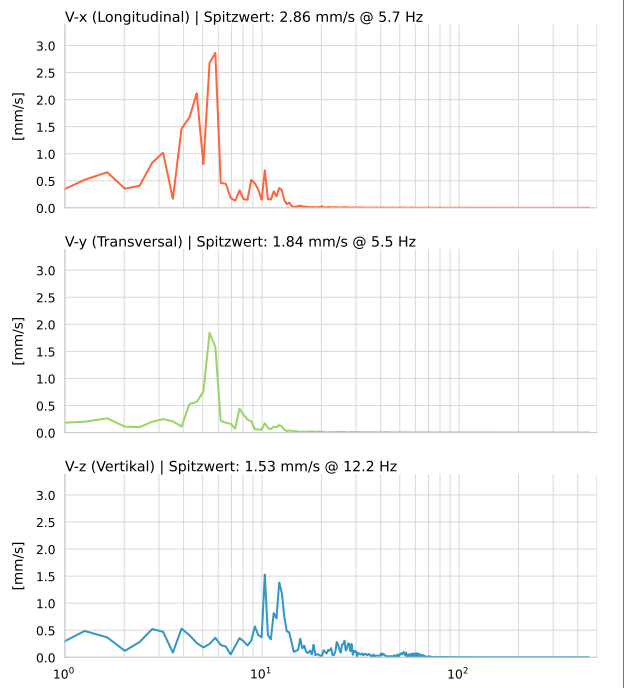

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.7 Hz	3.9 Hz	5.4 Hz	7.7 Hz
Y	5.5 Hz	5.0 Hz	5.8 Hz	8.8 Hz
Z	12.2 Hz	9.2 Hz	12.6 Hz	25.8 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

