


SCHWINGGESCHWINDIGKEIT

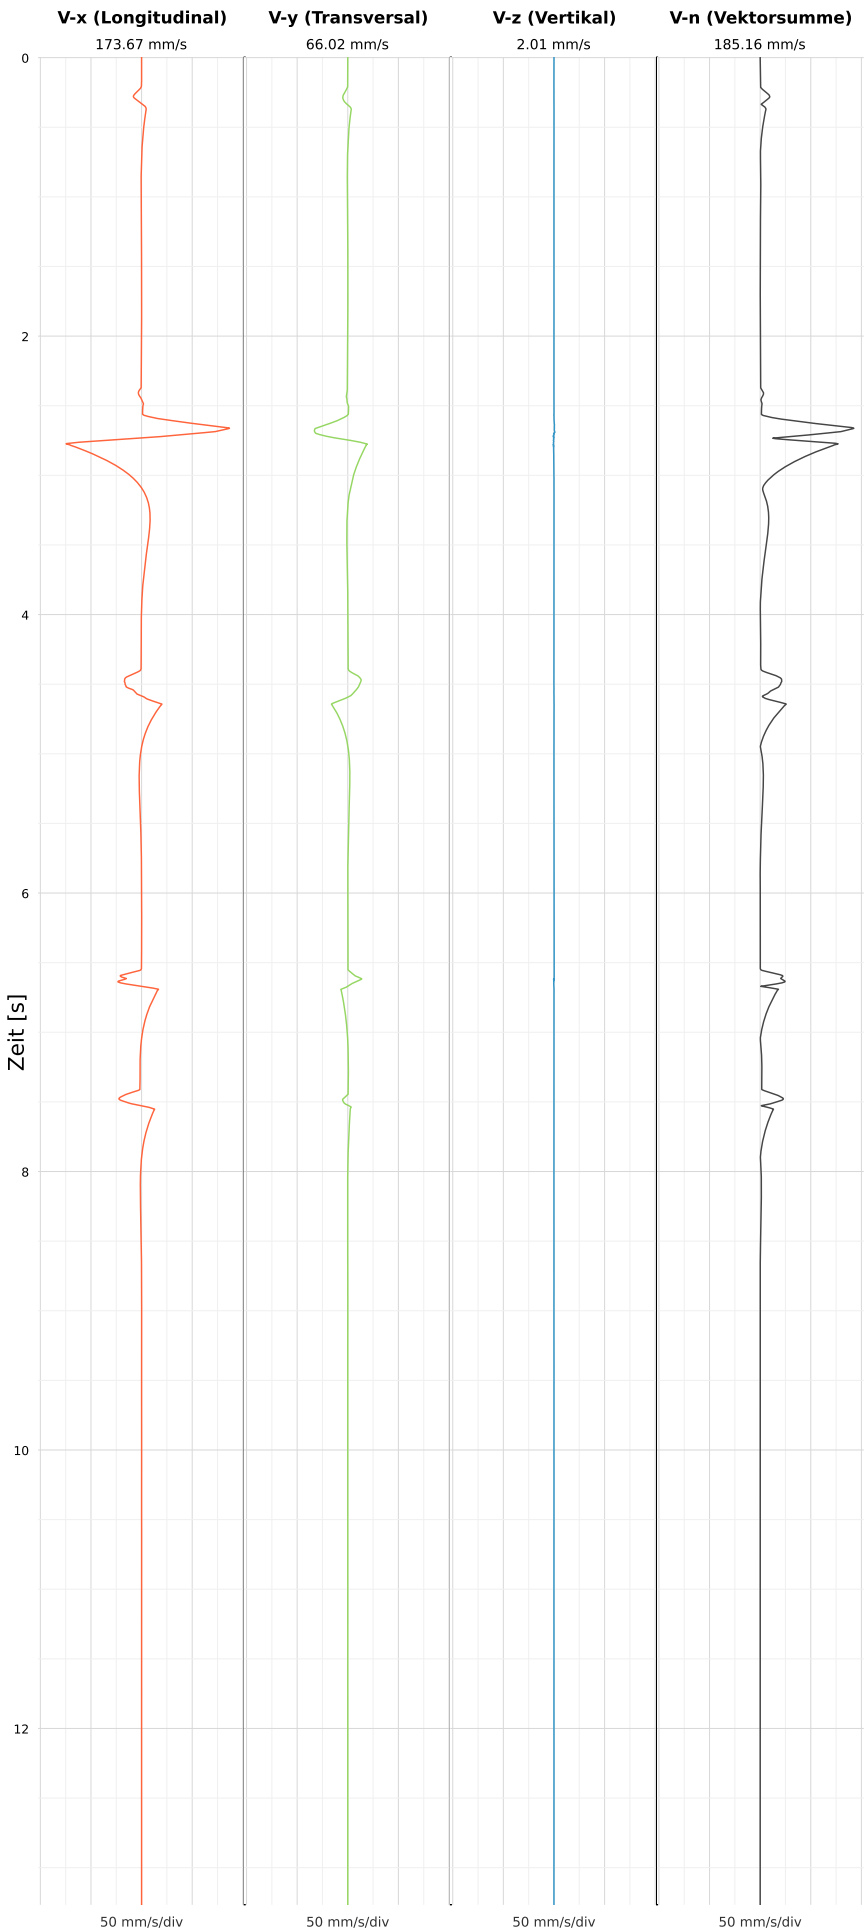

DATEI: 2493-PG4-03062026-085316_raw.csv

Aufzeichnungsdauer: 13.26 s | Abtaste: 1000 Hz

Datum:	03.06.2026
Zeit:	08:53:16
Event-ID:	2493-PG4-03062026-085316
Kalibrier Datum:	12.07.2025

Spitzwerte		
V-x (Longitudinal)	V-y (Transversal)	V-z (Vertikal)
173.67 mm/s	66.02 mm/s	2.01 mm/s
1.4 Hz	1.9 Hz	1.0 Hz
3473.41% von Limit	1320.44% von Limit	40.16% von Limit

V-n (Vektorsumme): 185.16 mm/s

