


SCHWINGGESCHWINDIGKEIT



DATEI: 2494-HF49-06082026-143100_raw.csv		
Aufzeichnungsdauer: 5.12 s Abtastrate: 1000 Hz		
Datum:	06.08.2026	
Zeit:	14:31:00	
Event-ID:	2494-HF49-06082026-143100	
Kalibrier Datum:	10.07.2025	
Spitzwerte		
V-x (Longitudinal)	V-y (Transversal)	V-z (Vertikal)
2.01 mm/s	0.49 mm/s	1.76 mm/s
18.6 Hz	11.7 Hz	16.0 Hz
28.09% von Limit	8.97% von Limit	27.04% von Limit
V-n (Vektorsumme): 2.33 mm/s		

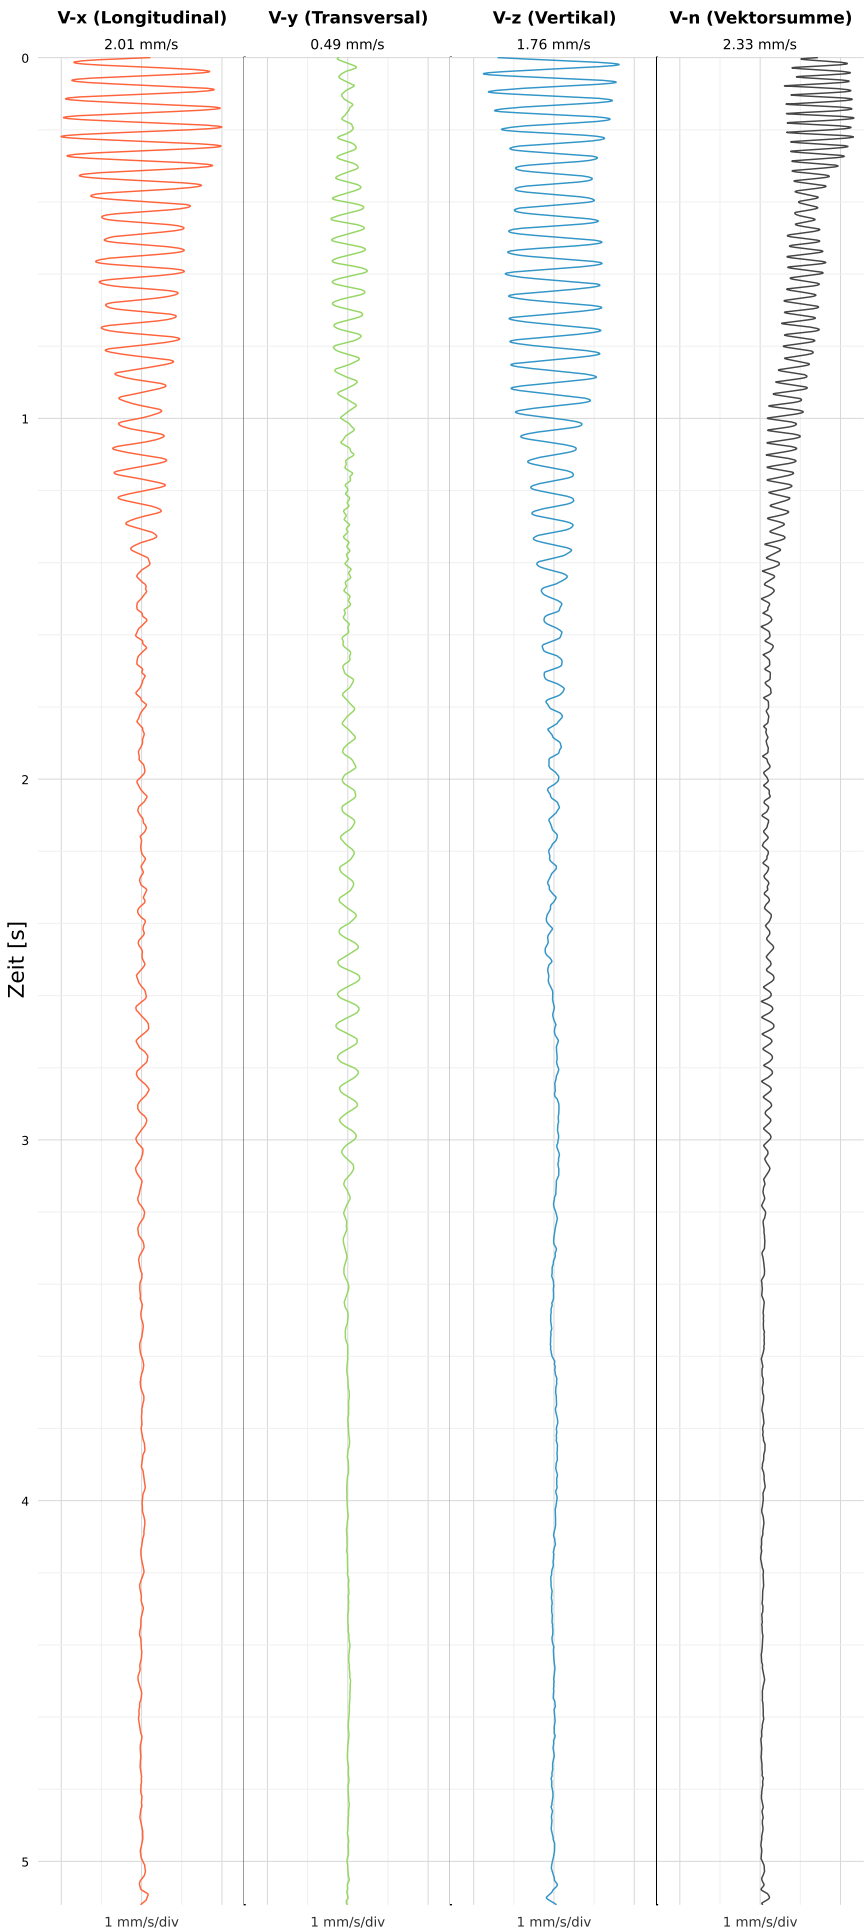